


**Item 608 Concrete Sidewalk**

DATE: 05/04/2020

SCALE: NONE

FILE: 2020-009.DWG

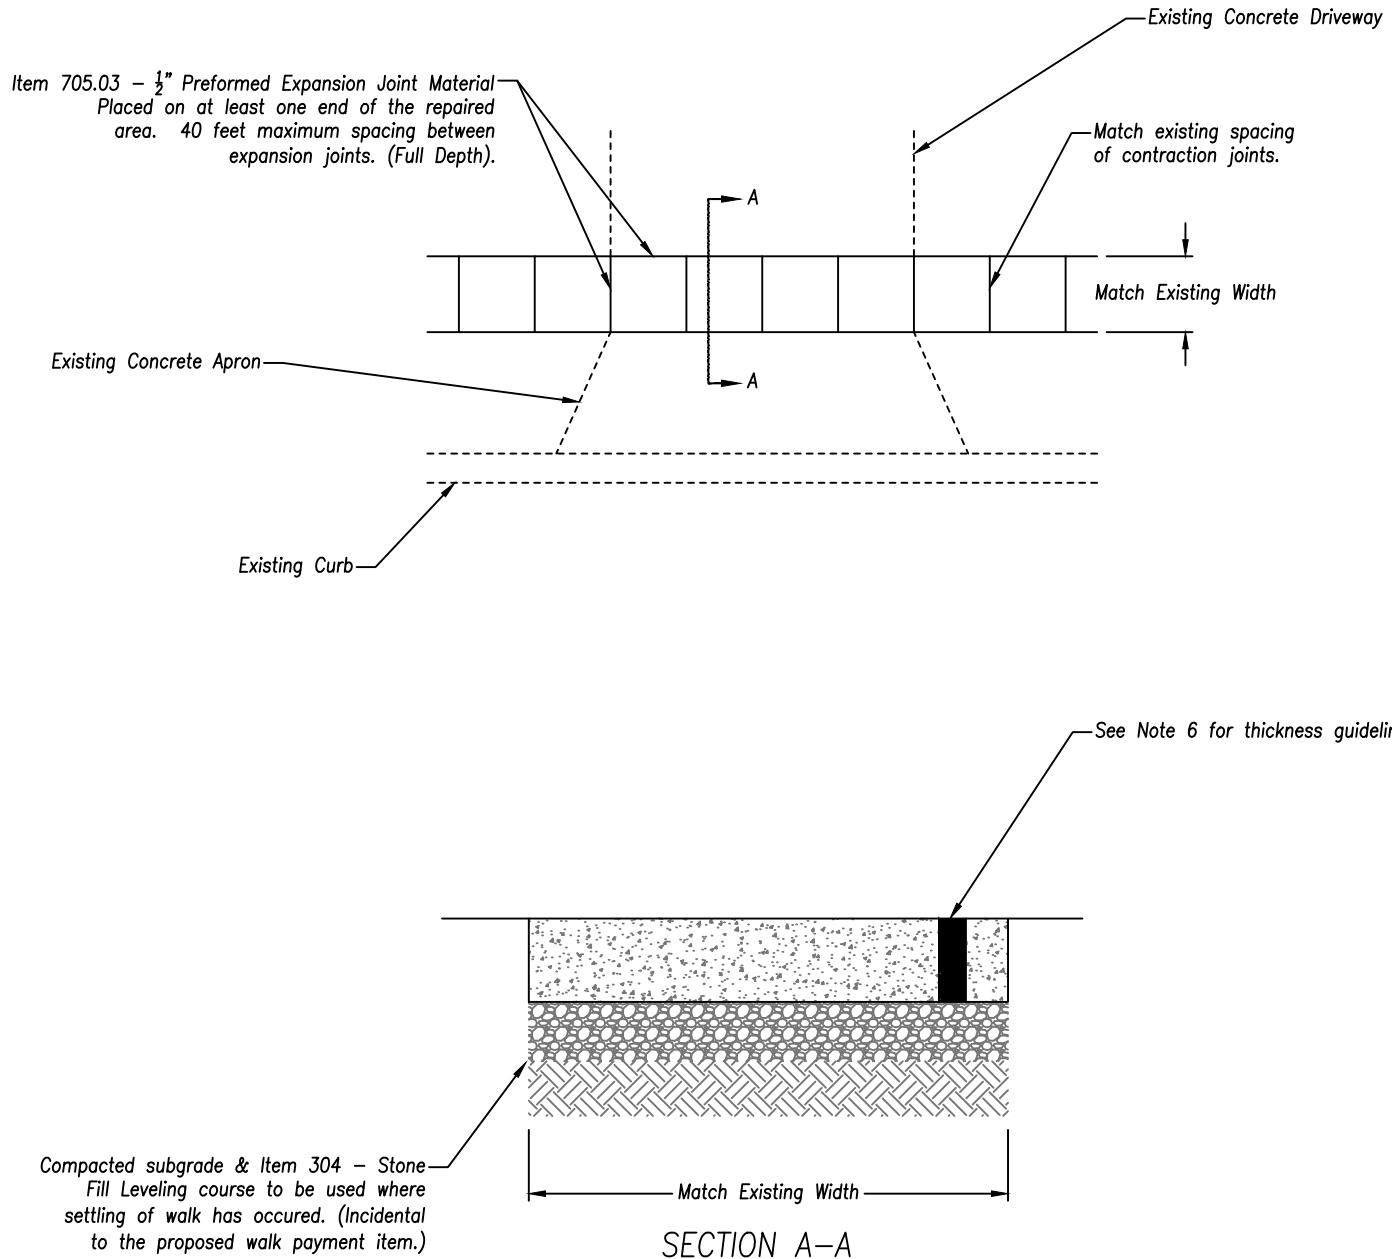

Notes:

1. The City shall mark in the field the walk to be replaced. Replacement walk shall match the line and grade of the existing walk and the joint pattern shall be maintained.
2. Item 705.03 - 1/2" Preformed Expansion Joint Material shall be placed on at least one end of the repaired area.
3. All repairs are to be made to the nearest joint.
4. The cost to repair any damage to adjacent walk or driveway by the contractor shall be incurred by the contractor.
5. The finish applied to the concrete walks shall be a light broom finish unless the resident requests a hand finish. All joints and outside edges may be tooled with an edger or joint tool after brooming or hand finishing to match adjacent concrete, as approved by the City.
6. Concrete to be ODOT Class C. Minimum thickness are determined by use as follows:
  - 6.1. Standard Walk: 4 inches, or match existing, whichever is greater.
  - 6.2. Walk through Residential Aprons: 7 inches
  - 6.3. Walk through Commercial Aprons: 9" inches
7. All disturbed yard areas shall be restored to grade, seeded, and mulched before the work is approved for payment and shall be incidental to Item 608 - Sidewalk, Remove and Replace.
8. Sidewalk in all new developments and redevelopments shall be 5 feet wide.