



Backflow Preventer General Setting

DATE: 05/04/2020

SCALE: NONE

FILE: 2020-012.DWG

12" from wall, min.

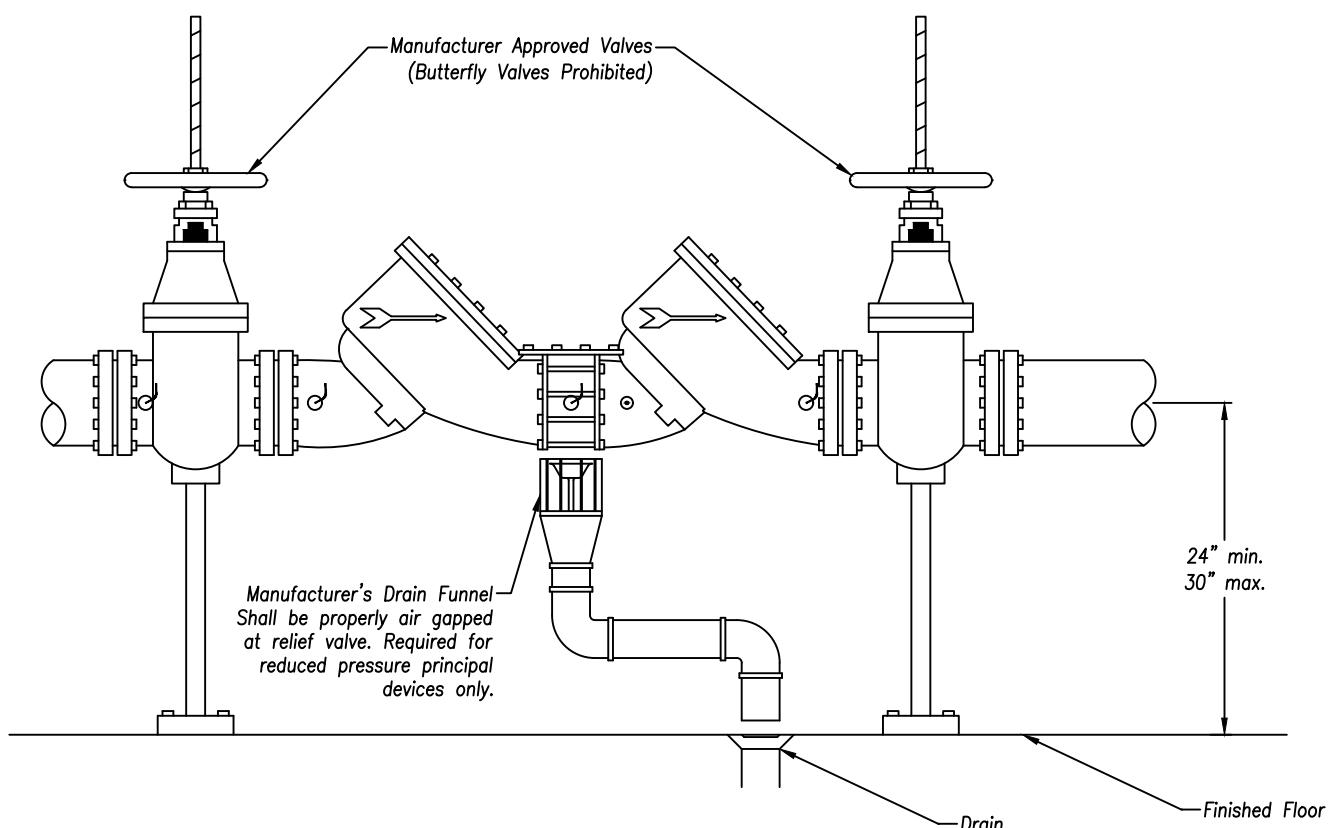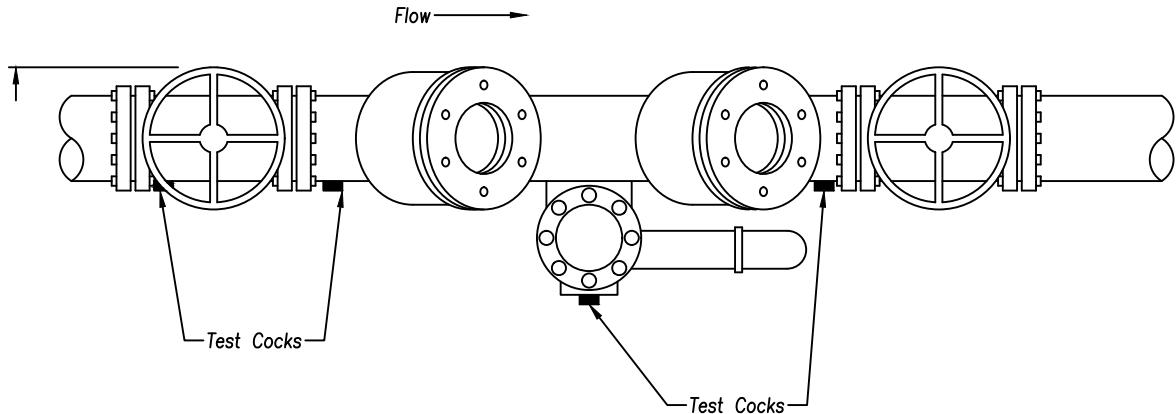

Notes:

Notes:

1. Backflow preventer shall always be installed downstream of meter.
2. Connection(s) to water line between meter and backflow preventer are prohibited.
3. Assembly to be mounted inside building or heated enclosure.